

FENCE DETAIL


FINAL INSPECTION: To be made after installation and completion of all elements of construction.

The following items will be checked at final inspection:

1. Wood fences shall be constructed of decay and termite-resistant material as specified in FBC Section 2328.
2. Wood fences shall be designed according to the loads as specified in FBC Section 2328
3. **EXCEPTION:** Unless designed by rational analysis, wood fences not exceeding 6' in height may be constructed to meet the following minimum requirements:
 - a. Vertical post of P.T. 4"x 4" spaced.
 - b. Post shall be embedded 2'0" into a concrete footing 10" in diameter.
 - c. Horizontal framing shall consist of a minimum of 3 horizontal rails of 2" x 4" P.T. material and shall be fastened with 2 16D nails at each post.
 - d. All lumber shall be a minimum of #2 grade or better.
 - e. All fasteners shall be corrosion resistant.

WARNING: Pre-manufactured sections may not comply with this code. Product Approval may be required.

Below is the detail for post spacing on wood fences:

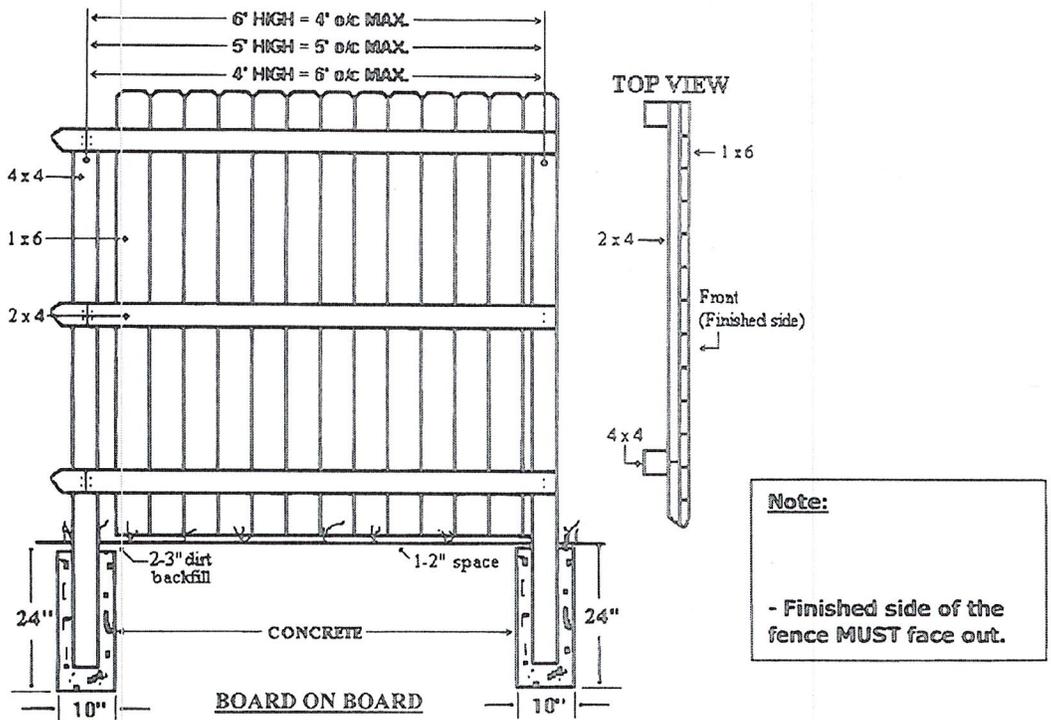

Other samples (designs may vary):

